



3DLevelScanner II

TECHNICAL DATA SHEET



*Changing the market
from level to volume*

APM's 3DLevelScanner™ incorporates advanced technology for accurately measuring bulk solids and powder stored in silos and open bins of all types.



OVERVIEW




Theory of operation

The APM 3DLevelScanner II is the only device presently available that delivers accurate measurement of bulk solids and powders - regardless of the type of material or product characteristics, type and size of storage silo, bin or container, and harshness of the storage environment.

The 3DLevelScanner II employs an array of three antennas to transmit low frequency pulses and to receive echoes of the pulses from the contents of the silo, bin or other container. Using three antennas the unit measures not only the time/distance of each echo but also its direction. The device's Digital Signal Processor samples and analyzes the received signals to provide very accurate measurements of the level and volume of the stored contents, and generates a 3D representation of actual allocation of product within the container for display on remote computer screens. It incorporates APM's unique dust-penetrating technology to achieve an unrivalled degree of process measurement and inventory control.

3D Mapping

- This unique device measures practically any kind of material stored in a large variety of containers, including silos, large open bins, bulk solid storage rooms, stockpiles and warehouses. It maps build-up loads and other irregularities that randomly form over time, offering solutions for this and many other previously inaccessible challenging applications.
- 3D representation of the stored contents for display on a remote computer screen.



LCD Display

Easy navigation
with 4-button operation

Same housing for all versions
(Ex and non-Ex)

Cable entry M20X1.5 (1/2 NPT)



Key Specifications

Preferred application:	Solids
Measuring range:	70 m (230 ft)
Process fitting:	Thread, Flange
Process temperatures:	-40...+85°C (-40...+185°F)
Process pressure:	-0.2...3 bar (-2.9...43.5 Psi)
Communication:	Active 4...20mA/HART/RS485/Modbus
Emitting frequency:	2 KHz to 10 KHz



Materials, non-wetted parts	
Housing	Painted aluminum die casting
Inspection window in housing	Polycarbonate
Antenna	Painted aluminum die casting
Weight	
3DLevelScanner II	5.6 Kg (12.35 lb)
Output variable	
Output signal	Active 4...20mA/HART/RS485/Modbus
Resolution	10 µA
Fault signal	Current output unchanged, 22 mA, >3.6 mA (adjustable)
Current limitation	22 mA
Maximal Load	400 Ohm
Communication	
Type	RS485/Modbus/HART
Ambient conditions	
Ambient, storage and transport temperature	-40...85°C (-40...+185°F)
Process conditions	
Vessel pressure	-0.2...3 bar (-2.9...43.5 PSI)
Process temperature	
Measured on the process fitting	-40...+85°C (-40...+185°F)
Vibration resistance	Mechanical vibrations with 2g and 5...200 Hz
Electromechanical data	
Cable entry/plug	1 x M20x1.5 (cable-Ø 8...12mm), 1 x blind stopper M20x1.5 Or 2 x cable entry ½ NPT
Display panel	
LCD	4 lines x 20 characters
Adjustment elements	4 keys

TECHNICAL DATA

Power supply – 4-wire instrument (Active) 4...20 mA / HART

Supply voltage 20...32 VDC

Power consumption max 1.5 W @ 24VDC

Electrical protective measures

Protection IP67 according to IEC 60529

Approvals

ATEX ATEX II 1/2D, 2D, Ex ibD/iaD 20/21 T110°C

ATEX II 2G Ex ia/ib IIB T4

FM FM Intrinsically Safe CL I,II, DIV I, GP CDEFG

NEPSI II 2G Ex ia/ib IIB T4

II 1/2D Ex ibD/iaD 20/21 T110°C

CSA cCSAus Intrinsic Safety (pending)

IECEX IEC EEx ia IIC T6 (pending)

CE

EMC

Emission EN 61326:1997 (class B)

Susceptibility IEC / EN 61326:1997 + A1:1998 + A2:2001 + A3:2003

NSR (73/23/EWG) EN 61010-1:2001

FCC

Conformity to part 15 of the FCC regulations

FCC 47 CFR part 15:2007, subpart B, class A


Measurement characteristics

Frequency 2 KHz to 10 KHz

Beam angle 30 - 70 degrees

Accuracy

Volume Accuracy - 3DLevelScanner II M/MV

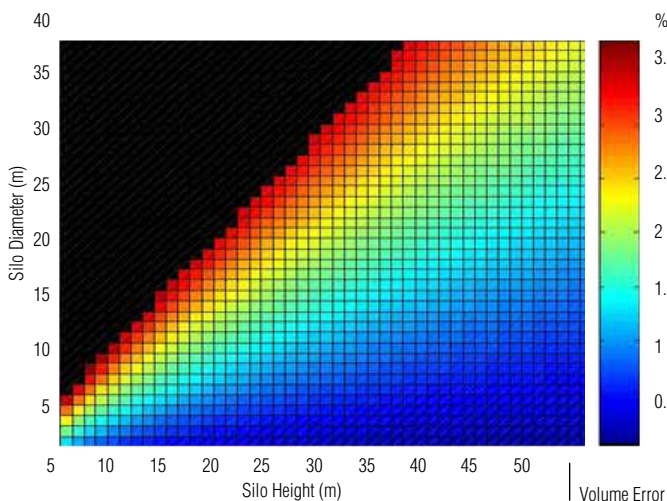

Test Case:

Silo dimensions:
Diameter = 10m, height = 20m

The material is cone sloped with 45°

Accuracy tolerance less than 3%





ELECTRICAL CONNECTION

General Requirements

In hazardous areas you should take note of the appropriate regulations, conformity and type of approval certificates of the sensors and power supply units.

PS OUT – Not to be used as loop power supply.

When multiple scanners and/or 3DLinkPro are connected with the same power supply, the total power consumption should be taken into account.

4...20 mA/HART 4-wire

Power supply and signal current are carried on two separate connection cables. The output signal is active, hence the PLC must be configured passive.


Connection Cable

RS485 cables should be shielded, twisted pair with 120 Ohm impedance, terminated by 120 Ohm resistors on both ends.

Avoid star topology wiring when connecting multiple scanners with on RS485 bus.

An outer cable diameter of 8 ...12 mm ensures the seal effect of the cable entry. If electromagnetic interference is expected, we recommend the use of screened cable for the signal lines.

Wiring Plans

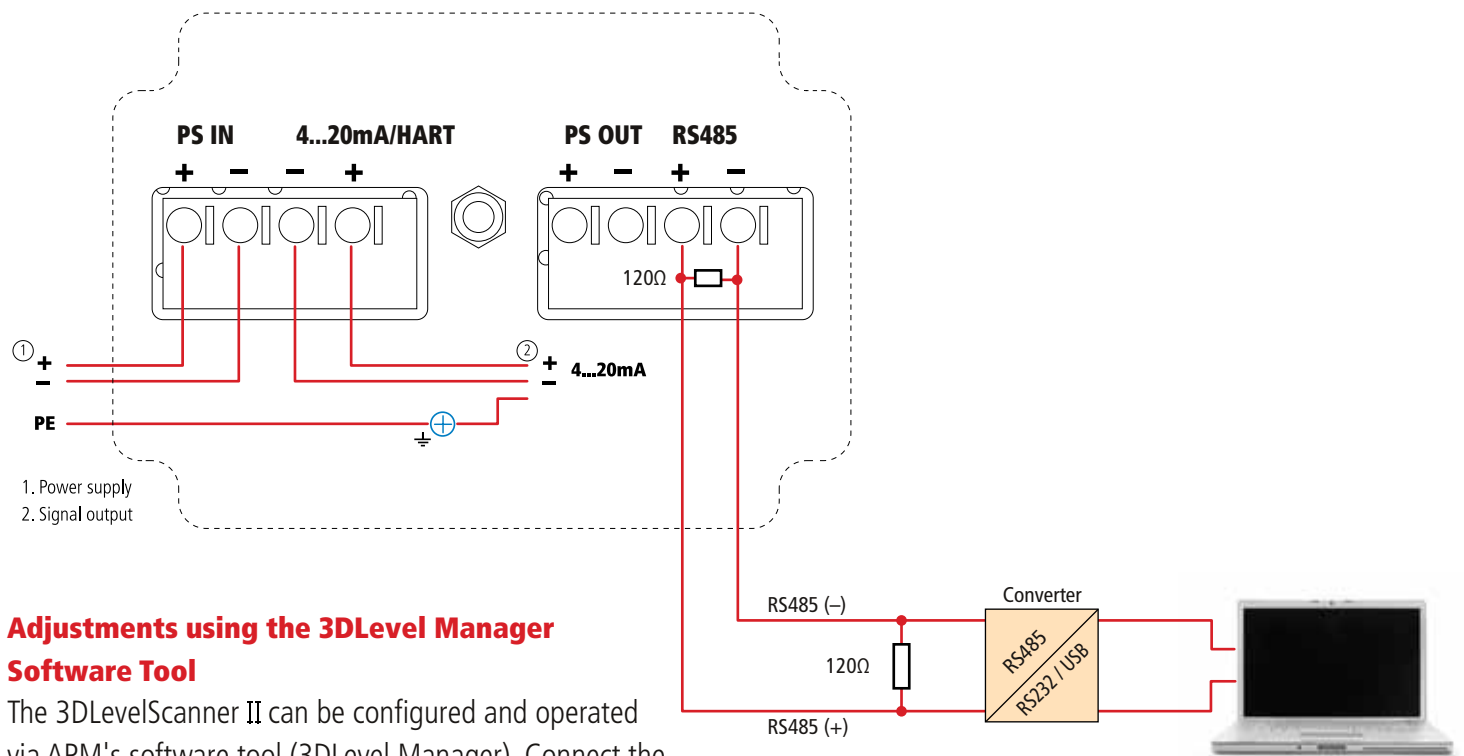


Adjustments using the 3DLevel Manager Software Tool


The 3DLevelScanner II can be configured and operated via APM's software tool (3DLevel Manager). Connect the 3DLevelScanner II according to the above diagram.

DIMENSIONS

3DLevelScanner II with horn antenna in threaded version

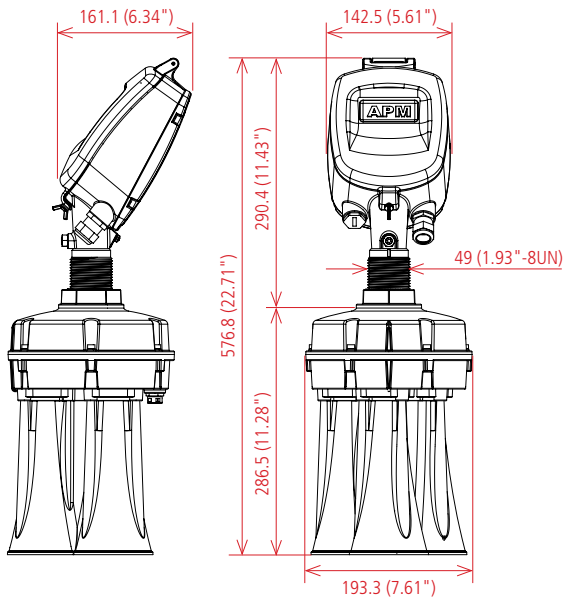


3DLevelScanner II Housing

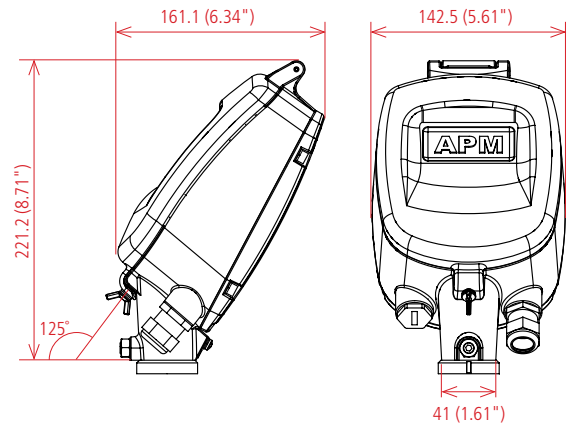


Dimensions in mm (inch)


Accessories Neck Extension

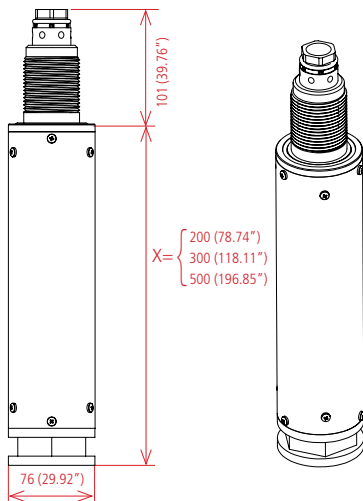


Head Body Separation Kit

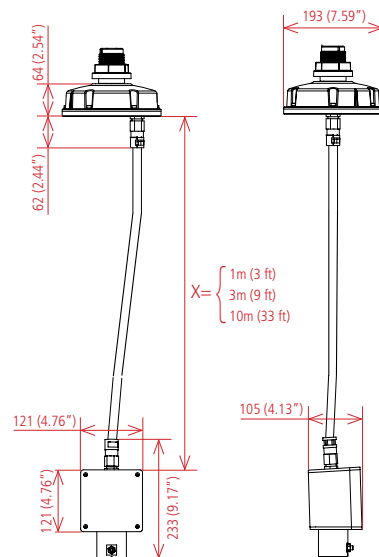

DN200 Flange

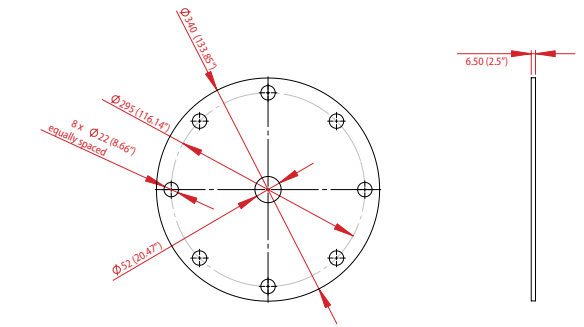

DN250 Flange

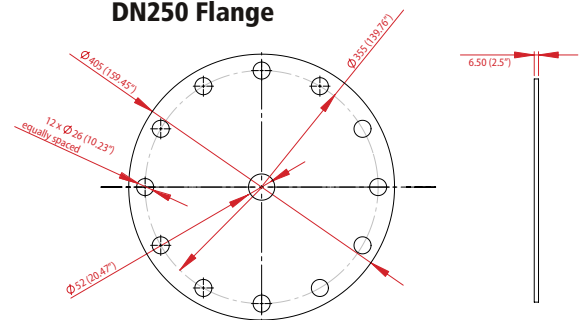


OPERATION

Installation Requirements

Direct 0° marker toward the center of the vessel.
Mount the 3DLevelScanner with a flange in parallel to the ground.

Adjustments Using the Display Panel

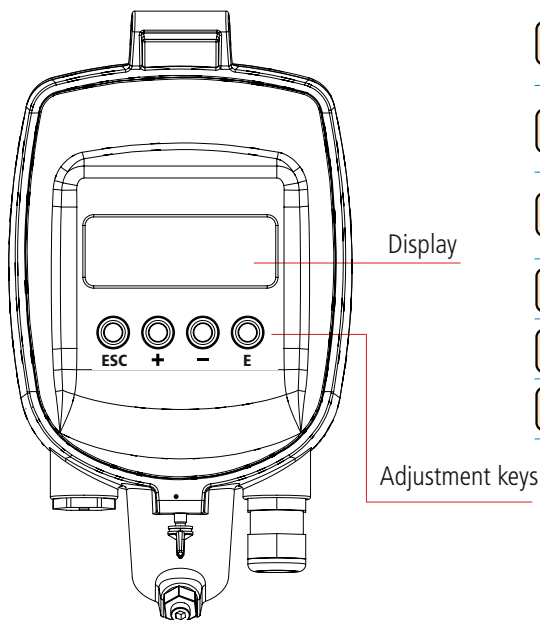

ESC	Navigate to the left within a function group; press ESC for 3 sec to go back to the basic screen
+	Navigate upwards in the selection list; edit numeric value within a function
-	Navigate downwards in the selection list; shifts to the right within a function
E	Navigate to the right within a function group; confirmation
+ and E	Increase contrast settings of the Display
- and E	Decrease contrast settings of the Display

3DLevelScanner II

Type

- S** For solid applications
- M** For solid applications with mapping capabilities
- MV** For solid applications with mapping capabilities and visualization graphics tool

Approvals

- XX** Without
- DX** ATEX II 1/2D, 2D, Ex ibD/iaD 20/21 T110°C
- GX** ATEX II 2G Ex ia/ib IIB T4
- FX** FM Intrinsically Safe CL I,II, DIV I, GP CDEFG
- CX** NEPSI II 2G Ex ia/ib IIB T4
II 1/2D Ex ibD/iaD 20/21 T110°C

Version / Material

- B** With horn antenna @195mm/ALU

Process connection

- GD** Thread 1.93" - 8 UN
- FE** Flange DN200
- FG** Flange DN250
- AD** Flange 6" 150lb RF, ANSI B16.5 / 316L
- AE** Flange 8" 150lb RF, ANSI B16.5 / 316L
- AF** Flange 10" 150lb RF, ANSI B16.5 / 316L

Electronics

- V** 4 ...20mA/HART – 4-wire/RS485/Modbus

Cable entry / Plug connection

- M** M20x1.5 / without
- N** 1/2 NPT / without

Neck Extension

- A** Without
- B** 200 mm (7.87")
- C** 300 mm (11.81")
- D** 500 mm (19.68")

Head Body Separation

- A** Without
- B** 1 m (3 ft)
- C** 3 m (9 ft)
- D** 10 m (33 ft)

3DLevelScanner



APM Automation Solutions Ltd.

ATIDIM High-Tech Industrial Park
Building 2 P.O. Box 58171
Tel Aviv 61580, Israel
Tel: +972 3 6488891
Fax: +972 3 6488892
info@apm-solutions.com
www.apm-solutions.com



Represented by

© 2011 APM Automation Solutions Ltd. All rights reserved. Information in this document is subject to change without notice. APM Automation Solutions Ltd. and the APM Logo, are trademarks, and the 3DLevelScanner is a registered trademark of APM Automation Solutions Ltd.